



LAC Series

Extruded Aluminum Combination Unit

Type: _____

Project/Location: _____

Contractor: _____

Prepared By: _____

Date: _____

Model No.: _____

FEATURES

- Solid metal construction, painted factory white
- Universal mounting: end, wall or ceiling
- Legend illuminated by white LED's warrantied for 10 years
- Comes standard with two pictogram films per face, for direction selection
- Twin LED lights provide up to 89 feet of egress illumination on a 6-foot wide path
- Twin 4W LED emergency lights provide 34 - 40 feet of egress illumination on a 6-foot wide path
- Sealed, maintenance-free Lead-Calcium battery
- Remote load capacity: 70' up to 350' feet of egress illumination when using LED remote heads
- Meets or exceeds CSA 22.2 No.141-15

See warranty details at: www.tnb.ca/en/brands/lumacell



nexus®

TYPICAL SPECIFICATIONS

Supply and install **Lumacell® LAC Series** combination of unit equipment and pictogram Exit Sign. The unit shall be suitable for universal mounting: wall, end, or ceiling. The unit shall include a power pack made of steel and a legend housing including a one-piece extruded aluminum frame. The legend housing shall have a maximum depth of 2-1/2". The face plate(s) shall be of extruded Aluminum and shall incorporate a protective clear polycarbonate panel. Each face plate shall come standard with two legend films for pictogram and direction selection. The light source shall be white light-emitting diodes (LED) and shall provide even illumination in normal and emergency operation. The power pack shall be complete unit equipment with battery charger and rechargeable battery. The battery shall be maintenance-free, sealed Lead-Calcium. In case of AC power failure the equipment shall provide minimum 30 minutes of emergency lighting. The rated DC power available for emergency lights shall be 27W or up to 80W, as specified. The emergency heads shall require no tools to adjust and aim. The heads shall be made of durable thermoplastic construction and include 4W MR16 LED lights or as otherwise specified.

Units with "auto-test option" shall include a micro-controller circuit to monitor all the critical functions of the equipment and execute periodical tests of: one minute every 30 days, 10 minutes every 6 months and 30 minutes every 12 months. In case of equipment malfunction, an LED-based diagnostic display shall generate a service alarm and indicate the cause of failure: battery, charger circuit, emergency lamps or Exit Sign lamps.

The equipment shall be CSA 22.2 No.141-15 certified.

The equipment shall be **Lumacell®** Model: _____ .

WIRE GUARDS

460.0081-L	Wall mount
460.0060-L	Ceiling mount



Type: _____
 Project/Location: _____
 Contractor: _____
 Prepared By: _____
 Date: _____
 Model No.: _____


LAC Series

Extruded Aluminum Combination Unit



DIMENSIONS

Dimensions are approximate and subject to change.

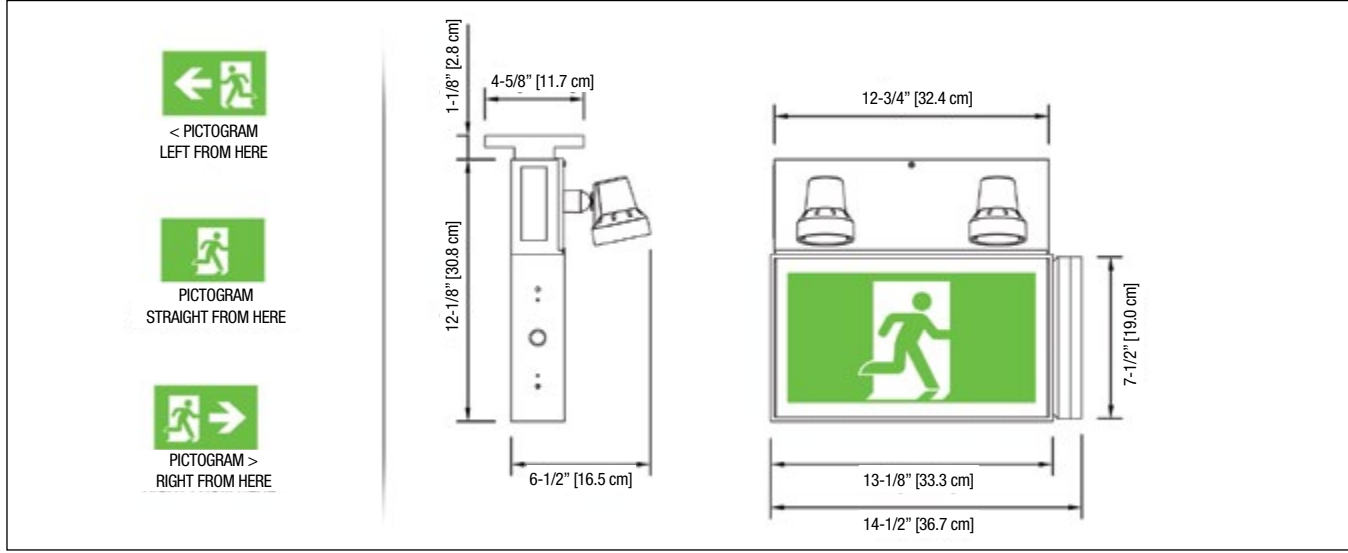

POWER CONSUMPTION

MODEL	AC SPECS	EMERGENCY POWER AVAILABLE FOR LAMPS					
		30MIN	1H00	1H30	2H00	4H00	
Pictogram module	120/347VAC	Less than 1.5W	-	-	-	-	-
LAC-627	120/347VAC	0.15/0.05A	27	16	11	9	-
LAC-640			40	23	16	13	-
LAC-672			72	42	30	24	12
LAC-1250	120/347VAC	0.25/0.09A	50	29	21	16	8
LAC-1280			80	46	32	27	13

ORDERING INFORMATION

SERIES	FACES / MOUNTING	COLOUR	POWER EM. LIGHTS	HEADS	HEAD STYLE AND WATTAGE	OPTIONS
LAC= pictogram aluminum combination unit	1= single face, universal mounting 2= double face, universal mounting	B= black W= factory white	627= 6V-27W 640= 6V-40W 672= 6V-72W 1250= 12V-50W 1280= 12V-80W	Blank= no head 1= one head 2= two heads	Blank= no heads LD1= MR16 LED, 6V-4W LD7= MR16 LED, 12V-4W LD9= MR16 LED, 12V-5W LD10= MR16 LED, 12V-6W MI= MR16 halogen, 6V-6W MJ= MR16 halogen, 6V-10W MK= MR16 halogen, 12V-12W MA= MR16 halogen, 12V-20W 130MB= MR16 halogen, 12V-35W* 130MR= MR16-IR, 12V-35W, high output* MT9= micro tungsten, 9W MT18= micro tungsten, 12V-18W, wedge base MQ8= micro halogen, 8W MQ12= micro halogen, 12W	ZC= 120/277VAC input AT= auto-test (audible)* ATN= auto-test (non-audible)* NEX= NEXUS® system interface* NEXRF= wireless NEXUS® system interface* TP= tamper-proof screws** T3= time delay (15 minutes)*** * Not available with 6V-72W * Not all options available with NEXUS® system interface. Please consult your sales representative ** 990.0119-L= tamper-proof bit (sold separately) *** Available with auto-test or Nexus® only

EXAMPLE: LAC1W1250LD7

Unlike Exit Signs this pictogram sign is not available in double arrow configuration.