



XP/RSTP Series LERE-XP

Hazardous Location Exit TP Series & Transfer Panel

Type: _____
 Project/Location: _____
 Contractor: _____
 Prepared By: _____
 Date: _____
 Model No.: _____

CSA certified for use in hazardous locations

The **LERE-XP Series** of "EXIT" signs are designed to cover emergency lighting applications for the entire spectrum of hazardous locations, where inflammable gases, vapors, liquids, dust particles or fabrics tissues are permanently present or are likely to exist. The **LERE-XP** Exit Signs can be connected to the **RSTP** transfer panel (see below), the **RG-X** Series of battery equipment, or the **Lumacell® DC system**.

FEATURES

LERE-XP Series Exit Signs

- CSA Certified for use in hazardous locations:
 - Class I, Divisions 1 and 2, Group A, B, C, D
 - Class II, Divisions 1 and 2, Group E, F, G
 - Class III, Divisions 1 and 2
- Die-Cast aluminum body with grey epoxy powder coat finish
- Exit housing and faceplate made of industrial-grade 14-gauge steel and finished in grey enamel
- Faceplate features universal knockout chevrons
- Two-wire input circuit for both AC and DC inputs
- Available in 6, 12, 24 and 120VAC/dc
- LED lamp with **ALINGAP** LEDs; consumes less than 5W in AC and DC mode
- New, easy-to-build catalogue number based on the Lumacell Severity Codes
- Meets or exceeds CSA 22.2 No.141-15

/RSTP Series Transfer Panel

- Available with hazardous location housing (Class I, Division 1) or NEMA-1 housing (for use outside the hazardous location area)
- Standard AC input: 120VAC, optional 277VAC, 347VAC; standard DC input: 6, 12 or 24VDC
- Two-wire output with permanently present AC/DC low voltage
- Output power: 25W, can drive up to five (5) units of the LERE-XP remote exit series
- Also available as Self-Powered Exit Sign, battery unit and combo unit; see RG-X catalogue sheet

TYPICAL SPECIFICATIONS

LERE-XP Series Remote Exit Sign:

Supply and install the **Lumacell® LERE-XP Series** remote Exit Sign. The exit housing shall be industrial grade 14-gauge steel and finished in grey enamel. The faceplate will be constructed of heavy-duty 14-gauge steel and feature universal knockout chevrons and the red letters shall not be less than 6" (150 mm) in height with a 3/4" (19 mm) stroke. The sign shall come complete with a _____ Volt LED lamp, and function from one voltage source only, in AC and DC current. The LED Lamp shall use **ALINGAP** LEDs and shall consume less than 5W in either AC or DC current.

The Exit Sign shall be CSA 22.2 No.141-15 certified.

The Exit Sign shall be suitable for Class _____, Division _____, Group _____.

The Exit Sign shall be **Lumacell®** Model: _____.

RSTP Series Transfer Panel:

Supply and install the **Lumacell® RSTP Series** transfer panel for hazardous location remote Exit Signs. The unit shall have two voltage inputs: _____ VAC and _____ VDC and shall be able to maintain an output of _____ Volts 25W for the permanent supply of a total of five remote LED Exit Signs.

The transfer panel shall be suitable for Class _____, Division _____, Group _____ or for a NEMA 1 environment.

The unit shall be **Lumacell®** Model: _____.



POWER CONSUMPTION AND UNIT RATING

MODEL	AC SPECS		DC SPECS	
AC/DC red two-wire	6VAC	Less than 5W	6VDC	Less than 5W
	12VAC		12VDC	
	24VAC		24VDC	
	120VAC		120VDC	

*NOTE: Exit Signs of 6,12 or 24 V must be connected through transfer panels; maximum five Exit Signs per panel.

1.

ENVIRONMENT	SEVERITY CODE
Cl. I, Div. 1, Gr. A, B	S1
Cl. I, Div. 1, Gr. C, D	S2
Cl. I, Div. 2, Gr. A, B, C, D	S3
Cl. II, Div. 1 & 2, Gr. E, F, G Cl. III, Div. 1 & 2	S4

2.

CERTIFICATION GUIDE FOR LERE-XP (40°C AMBIENT)				
Severity Code	S1	S2	S3	S4
Temperature Code	T6	T6	T4A	T6 (E,F,G)
CSA/UL rating	Max. 85°C (185°F)	Max. 85°C (185°F)	Max. 120°C (248°F)	Max. 88°C (190.4°F)

Type: _____
 Project/Location: _____
 Contractor: _____
 Prepared By: _____
 Date: _____
 Model No.: _____


XP/RSTP Series LERE-XP

Hazardous Location Exit TP
Series & Transfer Panel



DIMENSIONS

Dimensions are approximate and subject to change.

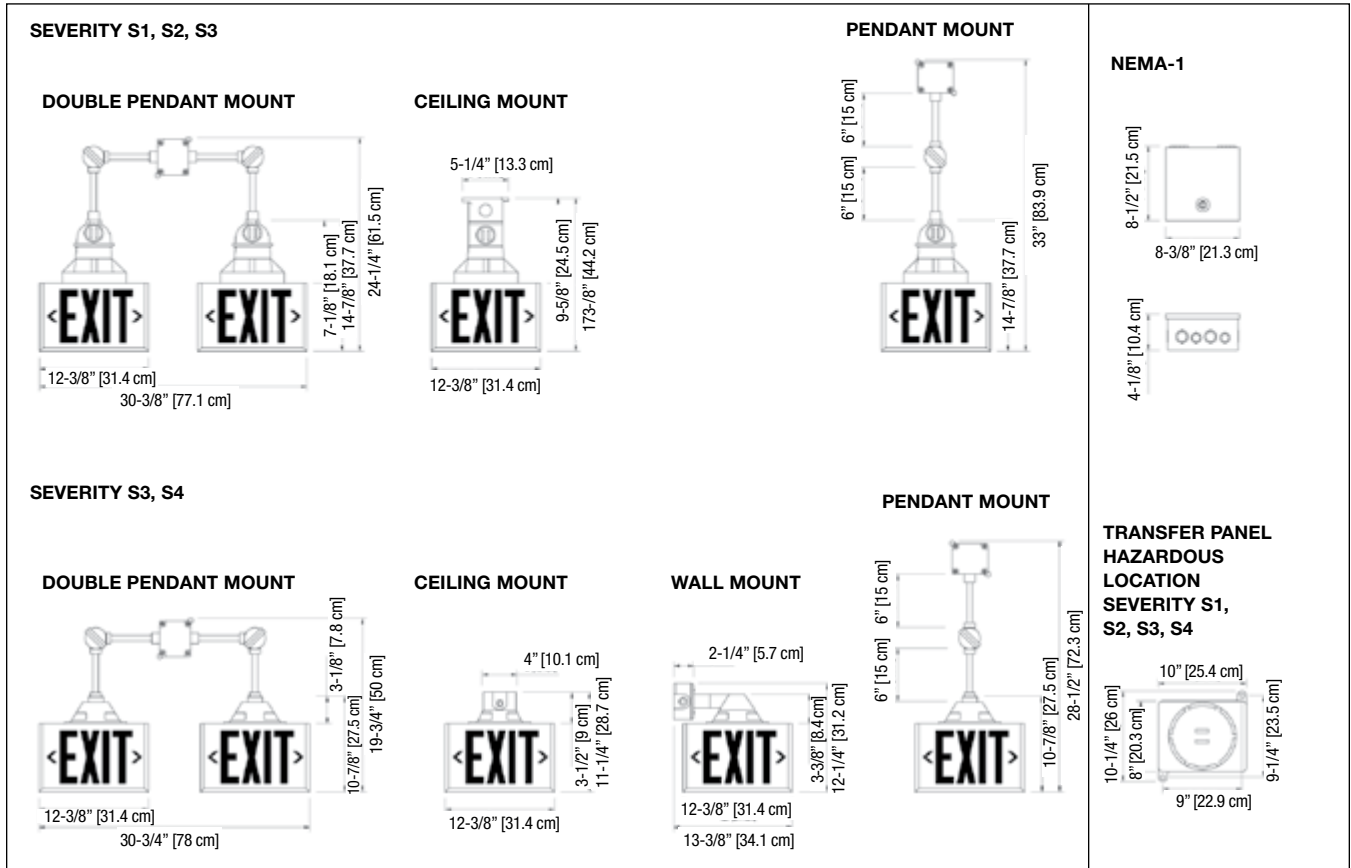

ORDERING INFORMATION

Before ordering, identify the environment of your application: Class _____, Division _____, Group _____. Refer to the table 1 for the Severity Code to use in your catalogue number. For temperature information, please look at the table 2.

3. LERE-XP

SERIES	VOLTAGE	SEVERITY CODE	MOUNTING
LERE1X = exit single face LED LERE2X = exit double face LED	-L6 = 6V -L12 = 12V -L24 = 24V -L120 = 120V	S1 = Cl. I, Div. 1 & 2, Gr. A, B S2 = Cl. I, Div. 1 & 2, Gr. C, D S3 = Cl. I, Div. 2, Gr. A, B, C, D S4 = CL. II, Div.1 & 2 Gr. E, F, G CL. III, Div.1 & 2	C = ceiling P = pendant W = wall* * Wall-mount available only for severities S2, S3 and S4.

EXAMPLE: LERE1X-L6S1C

4. TRANSFER PANEL

SERIES	AC VOLTAGE	DC VOLTAGE	WATTAGE	HOUSING
RSTP = transfer panel	120 = 120VAC 347 = 347VAC 277 = 277VAC	-6 = 6V -12 = 12V -24 = 24V -120 = 120V	-25 = 25W* * 5W required per DC Exit load	Blank = NEMA 1 XP = hazardous location

EXAMPLE: RSTP120-6-25