



new product

RGS-TBS Series

T-Bar 12V MR16 LED Unit

Type: _____
 Project/Location: _____
 Contractor: _____
 Prepared By: _____
 Date: _____
 Model No.: _____

Fully recessed units for T-Bar mounting in suspended ceilings.

The **RGS-TBS Series** battery units are designed for T-Bar ceiling grid installation. This slim-line, unobtrusive unit is ideally suited for any commercial location where there is limited wall space and where the greater directional flexibility of ceiling-mounted heads is needed to provide greater light distribution.

FEATURES

- Rugged steel cabinet with corrosion-resistant undercoating
- Battery and charger are concealed above the ceiling level in the unit cabinet
- Removable panel provides easy access to battery and circuitry
- Test switch and LED indicators are mounted on the visible bottom panel
- Units mount quickly and easily in standard 2' x 2' or 2' x 4' grids without any additional hardware
- Solid-state pulse-type charger – current-limited, temperature-compensated, short-circuit proof and reverse-polarity protected
- Unit comes standard with electronic lockout and brownout circuits
- Sealed dust-proof transfer relay, test switch and LED indicator lights
- Long-life, maintenance-free Lead Acid battery
- Standard 120/347VAC input voltage
- Available with a selection of 4W, 5W or 6W LED lamps
- Vandal resistance clear polycarbonate lens
- Optional tamper-proof screws available
- Meets or exceeds CSA 22.2 No. 141-15

See warranty details at: www.tnb.ca/en/brands/lumacell



nexus®

TYPICAL SPECIFICATIONS

Supply and install a complete emergency lighting system as described herein and shown on the drawings.

The **Lumacell® Smart Diagnostic** Micro controller board shall supply the rated load for a minimum of a 30 minutes to 87.5% of the rated battery voltage. The unit shall be rated 120V or 347V, 60 Hz and be CSA listed. The unit shall have an output of _____ V.

The charger shall be fully computer tested and its charge voltage factory set to $\pm 1\%$ tolerance. Chargers with field-adjusted potentiometers are not acceptable. A pulse-type charger shall be employed to promote long battery life and reduce the potential for grid corrosion. The charger shall provide a continuous high charge to recharge the battery, when the battery is at full capacity, the charger will shut-off. Periodically the charger shall provide a pulse of energy to keep the battery topped off. The charger shall be current limited, temperature compensated, short-circuit proof and reverse polarity protected. The unit shall be furnished with an electronic lockout circuit, which will connect the battery when the AC circuit is activated, and an electronic brownout circuit, which will activate the emergency lights when utility power dips below 75% of nominal voltage.

A low voltage battery protection circuit shall be provided and will disconnect the battery from the fused output circuit at the end of discharge. The unit shall self-test for 1 minute every 30 days, 10 minutes on the 6th month and 30 minutes every 12 months. The unit shall be capable of full recharge in compliance with CSA specifications. The unit shall be furnished with sealed dust tight relay, a test switch and seven diagnostic LED indicator lights to continuously monitor the status of the unit: Battery Failure, Battery Disconnected, Charger Failure, Lamp Failure, Service Alarm, AC "ON", Charger High Rate. The unit shall be T-bar mounted and come complete with tool-less emergency lighting heads requiring no tools to adjust or aim.

The unit shall be CSA 22.2 No.141-15 certified.

The unit shall be Lumacell® model: _____ .

REPLACEMENT LAMPS

ORDERING CODE	LAMP TYPE	VOLTAGE/WATTAGE
580.0093-L	MR16, LED	12V-4W
580.0104-L	MR16, LED	12V-5W
580.0106-L	MR16, LED	12V-6W

Type: _____
 Project/Location: _____
 Contractor: _____
 Prepared By: _____
 Date: _____
 Model No.: _____




RGS-TBS Series

T-Bar 12V MR16 LED Unit

DIMENSIONS

Dimensions are approximate and subject to change.

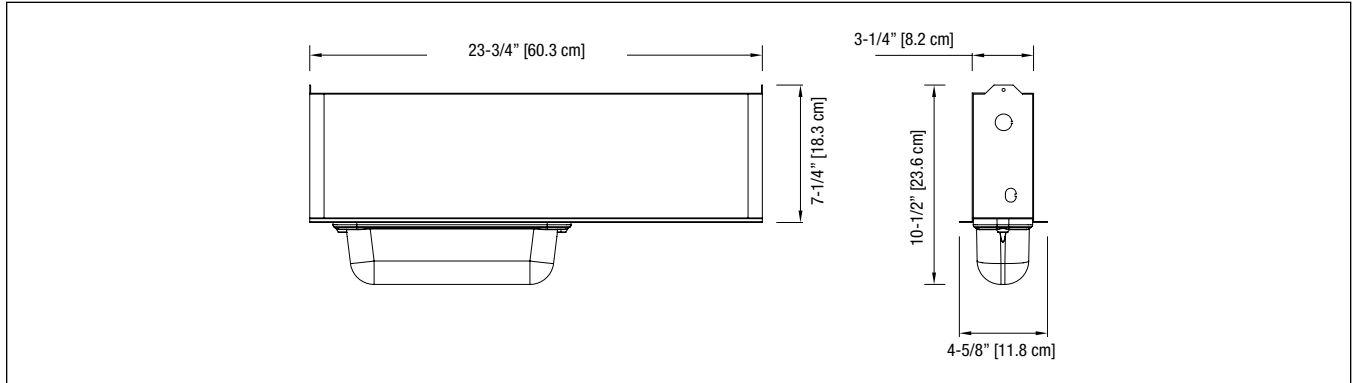

POWER CONSUMPTION AND UNIT RATING

MODEL	AC SPECS	WATTAGE CAPACITY					
		30MIN	1H00	1H30	2H00	4H00	
RG12S36TBS	120/347VAC	0.09/0.03A	36	21	15	12	-
RG12S72TBS		0.15/0.06A	72	42	30	24	12

ORDERING INFORMATION

SERIES	CAPACITY	HOUSING	# OF HEADS	HEAD STYLE LAMP WATTAGE	COLOUR	AC VOLTAGE	OPTIONS
RG12S= 12V	36= 36W 72= 72W	TBS= T-bar cabinet	2= two heads 3= three heads	LD7= MR16 LED, 12V-4W LD9= MR16 LED, 12V-5W LD10= MR16 LED, 12V-6W	Blank= factory white	Blank= 120/347 VAC input	AT= auto-test, audible ATN= auto-test, non-audible NEX= NEXUS® wired system interface* NEXRF= NEXUS® wireless system interface* CT= cab-tire LD= lamp disconnect LTS= light activated test switch RR2= remote Test Receiver (remote test transmitter needed)** TL= twist Lock Plug (120V only) TMBB= AC/DC Terminal Block TMBD= DC Terminal Block TMBK= AC Terminal Block TP= tamper proof screws (tamper proof bit needed)*** T3= time delay (programmable)

* Not all options available with NEXUS® System. Please consult your sales representative.
 ** HH2= remote test transmitter (sold separately)
 *** 990.0119-L= tamper proof bit (sold separately)

EXAMPLE: RG12S36WTBS2LD7